


FRONT OF TRANSFORMER
(IDENTIFY BY DISTRICT
TRANSFORMER NUMBER,
LOCKING DEVICE AND "KEEP
CLEAR 12 FT." STICKER)

NOTES:

- NO OBSTRUCTIONS ALLOWED OVER TRANSFORMER
- A MINIMUM 8 FT. CLEARANCE IS REQUIRED FROM ALL DOORS AND WINDOWS.
- DRAINAGE AT PADMOUNT TRANSFORMER MUST BE AWAY FROM BUILDING IN CASE OF OIL LEAKAGE.
- REFER TO PUD LANDSCAPING GUIDELINES 207.1

247_1.DGN

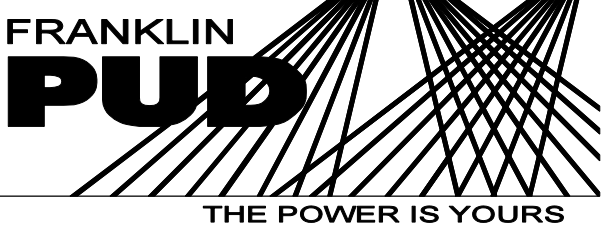

TYPICAL TRANSFORMER CLEARANCES

DWN. SKH/DBO	DATE: 1-14-97	DWG. NO. 247.1
APP.		